

Section 6.1 Mechanical Requirements

Draft IPRD Requirement RBPRD-0067:

FROM:

The Instrument dimensional envelope, including deployable mechanisms, shall not exceed 0.95 m × 0.95 m × 0.95 m.

TO:

The Instrument dimensional envelope, including deployable mechanisms, shall not exceed the volume shown in Figure 6.1-1.

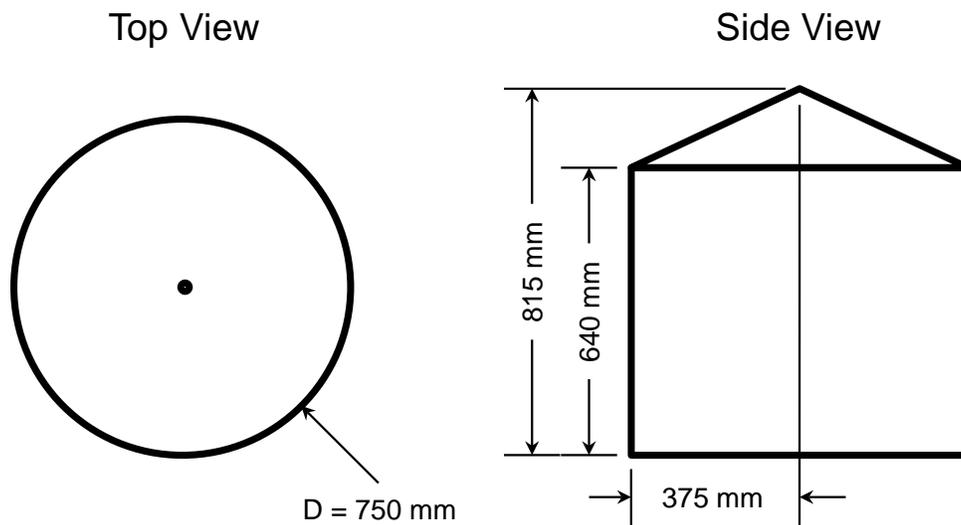


Figure 6.1-1 Instrument Dimensional Envelope

Section 6.4.6.2.2 Instrument Purge Equipment

Draft IPRD Requirement RBPRD-0128:

FROM:

Instrument purge covers and/or bagging shall remain within the Instrument mechanical envelope defined in Section 6.1 of this document.

TO:

Instrument purge covers and/or bagging shall remain within the diameter of the Instrument mechanical envelope defined in Section 6.1 of this document.